



Gortnalug 110kV Substation and Grid Connection Zone of Theoretical Visibility (ZTV) Figure 1.2

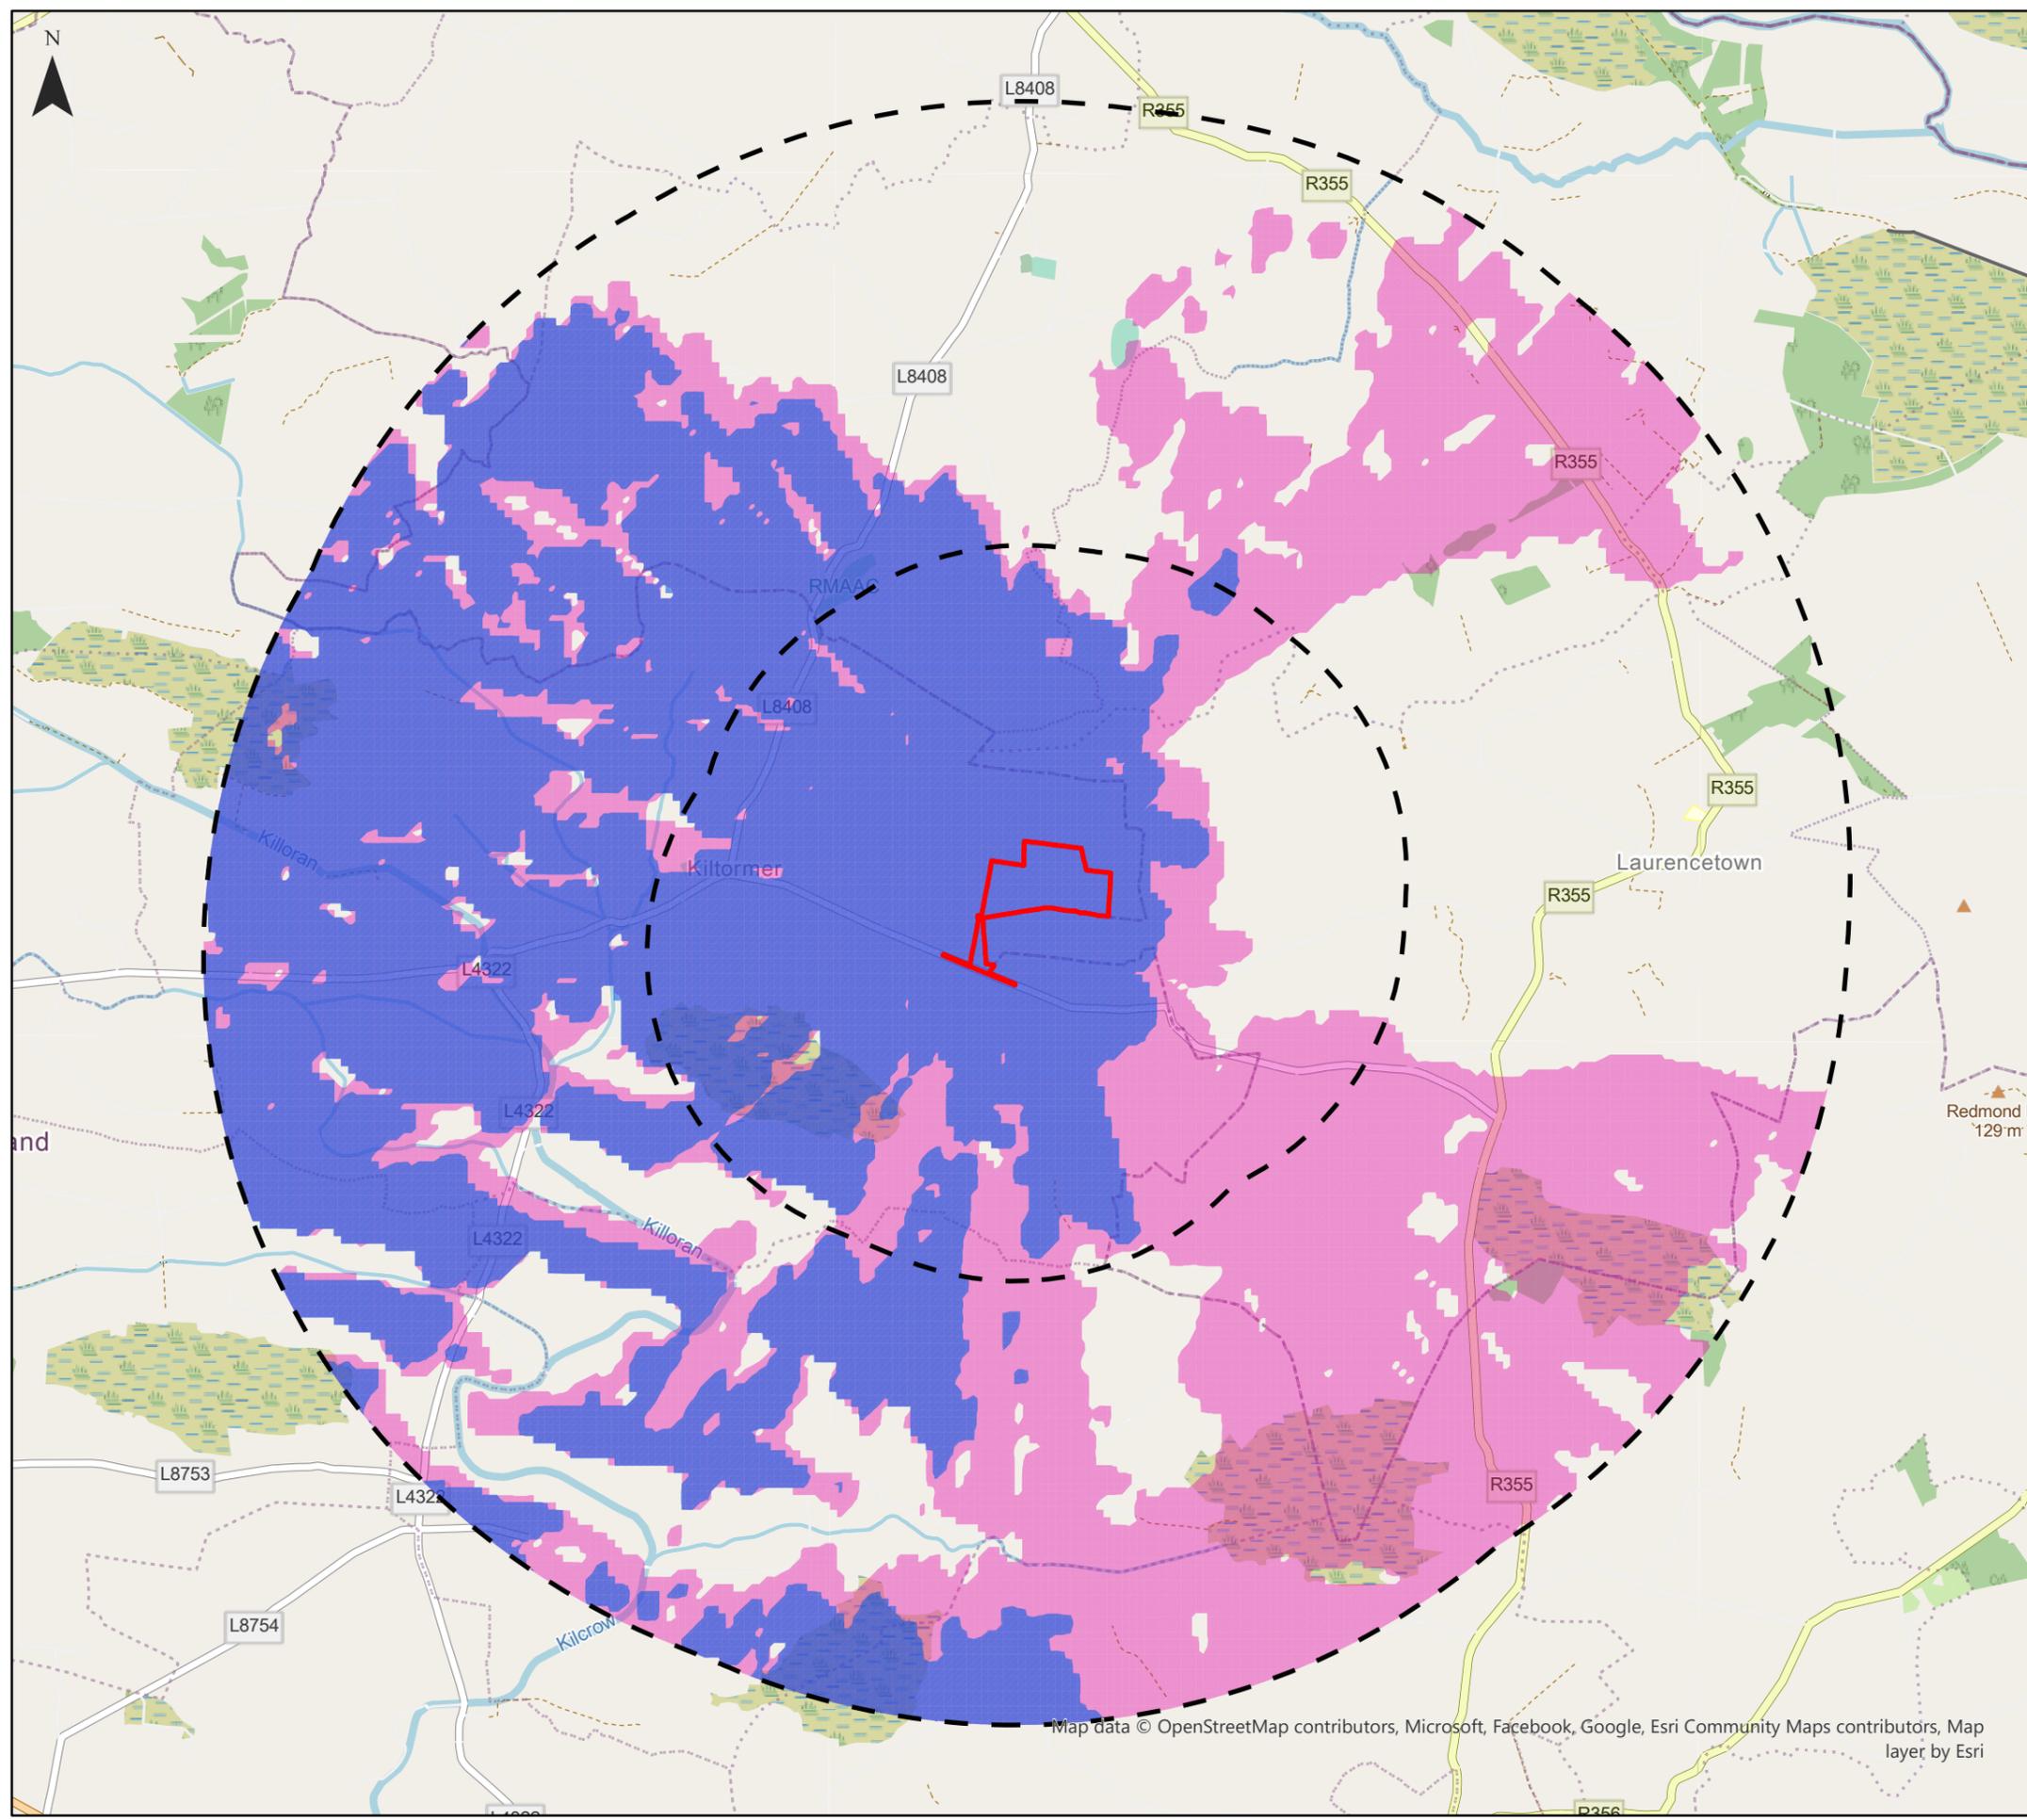

Key

-  Development Boundary
-  2km, 5km Study Area
-  Infrastructure Zone of Theoretical Visibility (ZTV)
-  Lighting Masts Zone of Theoretical Visibility (ZTV)

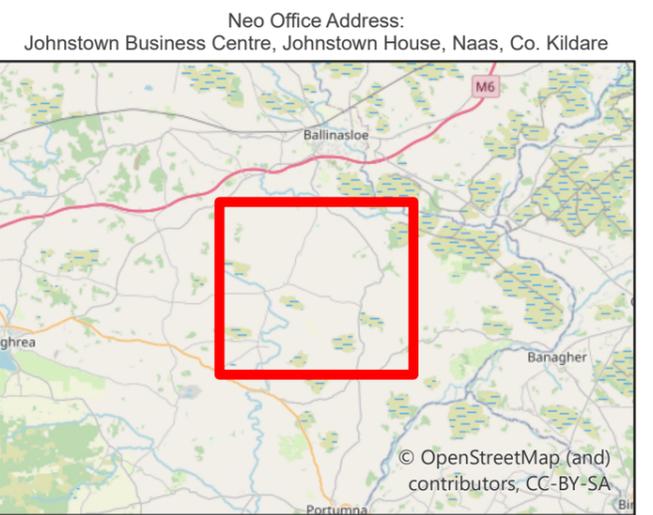

Date: 11/12/2025
 Drawn By: David Miller
 Scale (A3): 1:45,000
 Drawing No: NEO01668/0131A

