


ESB/EirGrid Easement 7.32m Minimum IPP 33kV Easement 2m Minimum

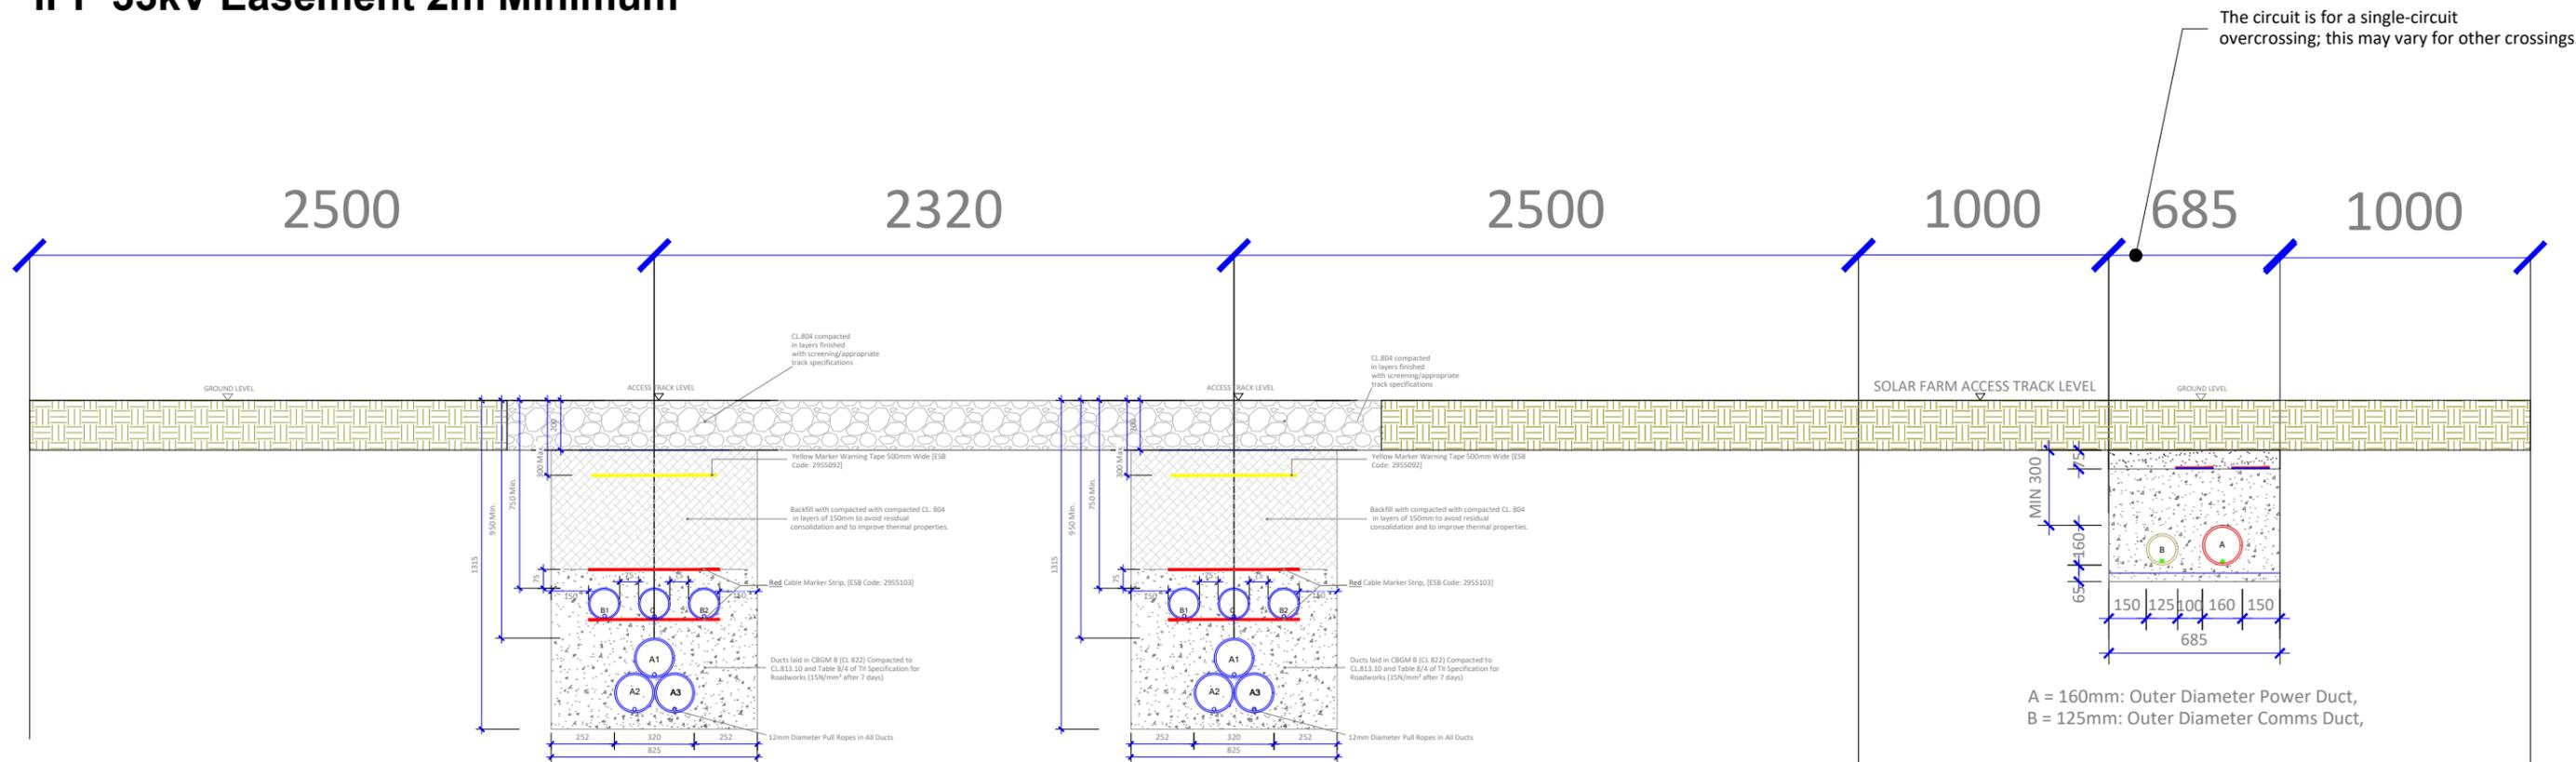

- A = 160mm: Outer Diameter HDPE ESB Approved Coms Duct, SDR=17.6
- B = 125mm : Outer Diameter HDPE ESB Approved Power Duct, SDR= 17.6
- C = 110mm : Outer Diameter HDPE ESB Approved Power Duct, SDR= 17.6

Minimum Easement Width Through Off Road Sections

NTS

Note:

- This drawing is to be read in conjunction with relevant drawings, specifications and reports
- Dimensions are in millimeters, unless noted otherwise
- Drawings are not to be scaled use figured dimensions only

ALL REINSTATEMENT WORKS ARE TO BE IN ACCORDANCE WITH LANDOWNERS/ESB REQUIREMENTS



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

CLIENT



PROJECT

Gortnalug 110 kV Substation
Loop In and Out Grid Connection

PROJECT NUMBER
300-101338

SHEET NUMBER
300101338-DR-219

SHEET TITLE

Minimum Easement Width
Section View

DRAWING STATUS
For Information

ISSUE/REVISION

ISSUE/REVISION	DATE	DESCRIPTION
P1	8.12.25	Issued for Information
I/R	DATE	DESCRIPTION